


# Ball diffuser rail

Type KS



**TROX<sup>®</sup> TECHNIK**

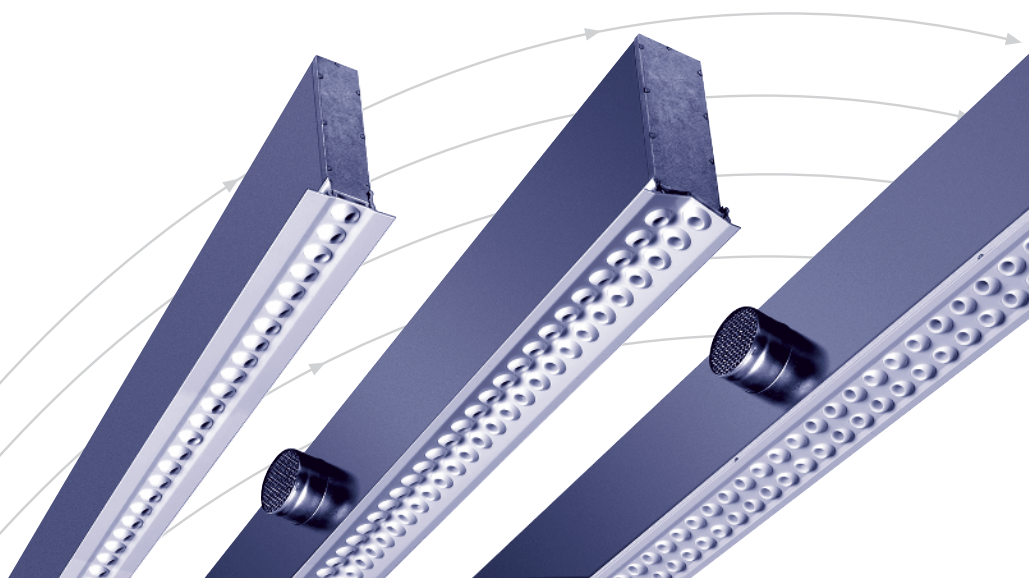

TROX HESCO Schweiz AG  
Walderstrasse 125  
Postfach 455  
CH - 8630 Rüti /ZH

Tel. +41 (0)55 250 71 11  
Fax +41 (0)55 250 73 10  
[www.troxhesco.ch](http://www.troxhesco.ch)  
[info@troxhesco.ch](mailto:info@troxhesco.ch)

## Contents

Application · Realisation	2
Realisation · Discharge Positions	3
Dimensions	4 and 5
Installation	6 and 7
Quick selection	8-10
Definitions	11
Technical Data	12-29
Order details	30

## Application

Ball diffuser rails are supply air elements, which can be incorporated into ceilings especially aesthetically. They are suitable for air conditioning systems in open-plan offices, class rooms, laboratories, booking halls, etc. The adjustment possibilities for the individual ball jets are well-nigh unlimited, because they can be set to blow in any desired direction. The ball rails can be supplied in single or double-row versions.

Ball diffuser rails are suitable for:

- systems with constant air volume
- systems with variable air volume (VAV)  
min. air volume = 25% of the max. air quantity
- $\Delta T$ : - 12 to 10 K


## Realisation

Ball diffuser rails are made of aluminium profiles with a coloured matt-finish according to RAL 9010, 25% brilliance. The desired air discharge setting is adjusted at works. Subsequent resetting of the ball jets can be made with the aid of a setting pin. The ball rails can also be supplied in other RAL colours. The plenum box is made of galvanised steel. Fixed resistance FW0066 in the tube connection. Special designs on request.

# Realisation · Discharge positions


## Standard model

Balls arranged in parallel (F79 + W100)











## Special model

Ball diffusers offset (with VF79 + VW100)  
Designation: V



Standard model of KS2 WK 100


## Discharge positions 1 - 7b

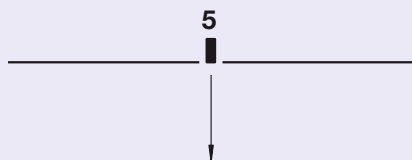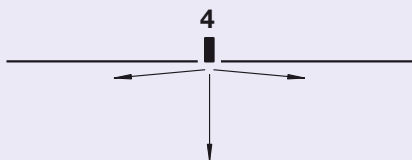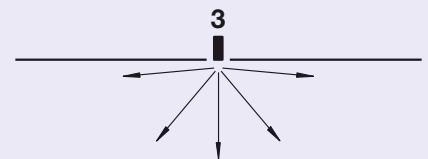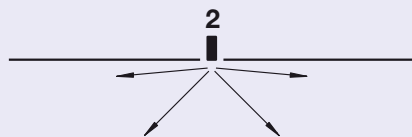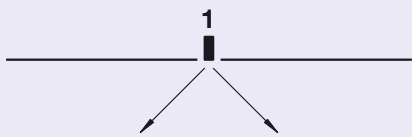


# Dimensions

## Ball rails, single row


### KS1 F43



### KS1 WE63




### KS1 W83

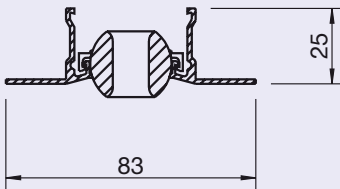


## Ball rails, double row


### KS2 F79

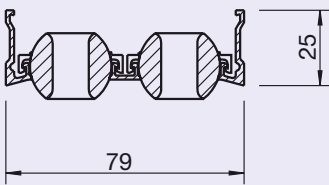


### KS2 W100

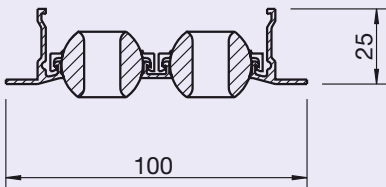


### KS2 WK100

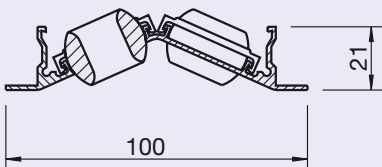

## With plenum box KS1 F43 K190

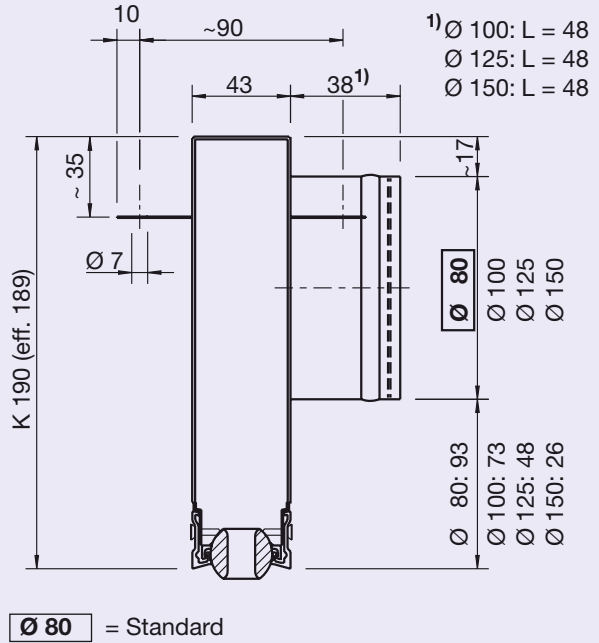


## With plenum box KS2 F79 K220

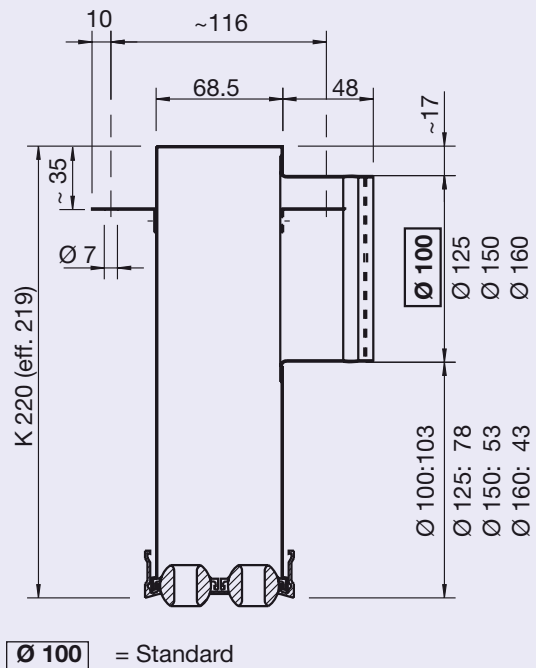


# Dimensions


Lengths in excess of 2000 mm are supplied in sections. Longitudinal measurement B, where possible, divided by 33.3. They can be connected flush to form a continuous rail with the aid of grooved pins. Attachment brackets for ball diffuser rails without connection boxes has to be ordered separately (surcharge).

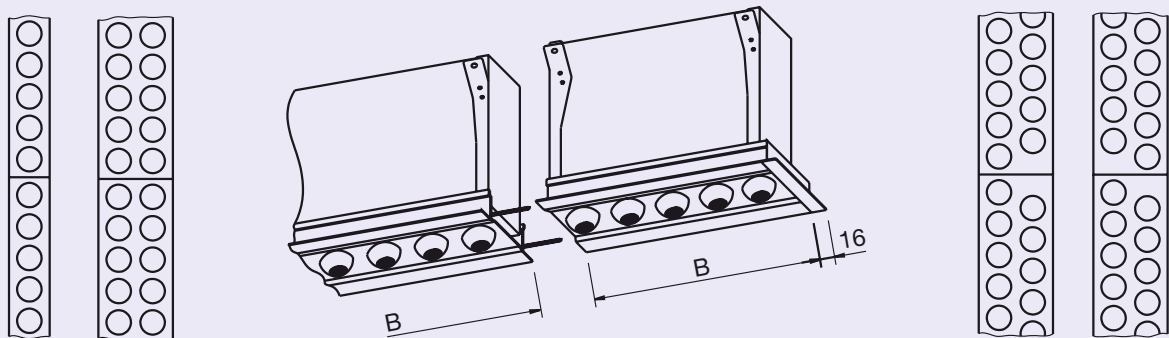

Recess dimensions **without** transversal angle


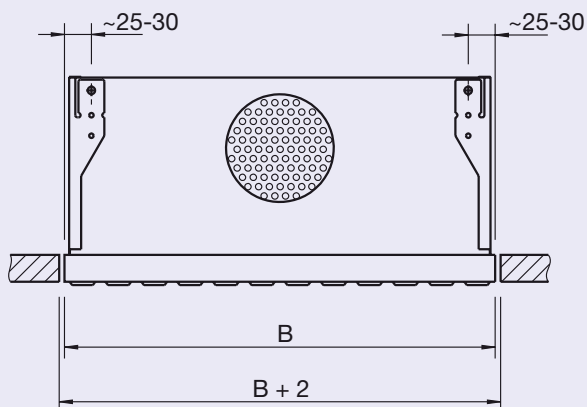


Recess dimensions **with** transversal angle (B + 15)

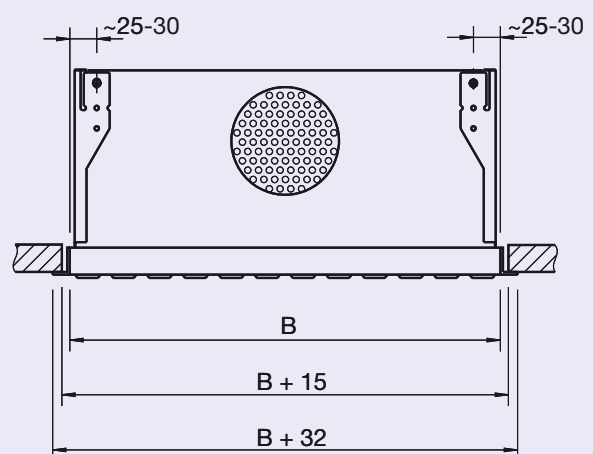



# Installation

## Standard models

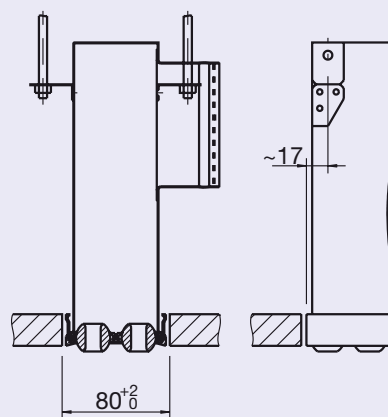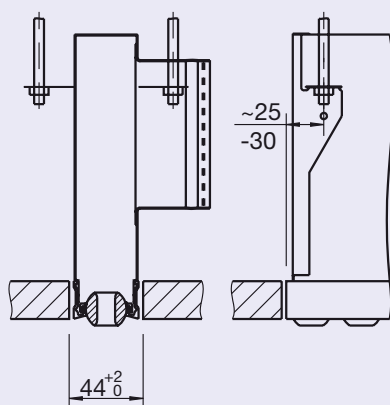


Attachment material, building contractors' supply

## Special attachment angles on request

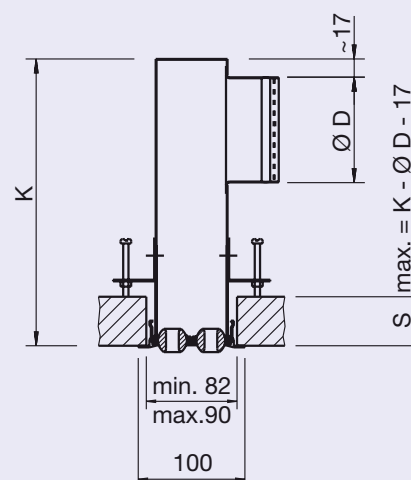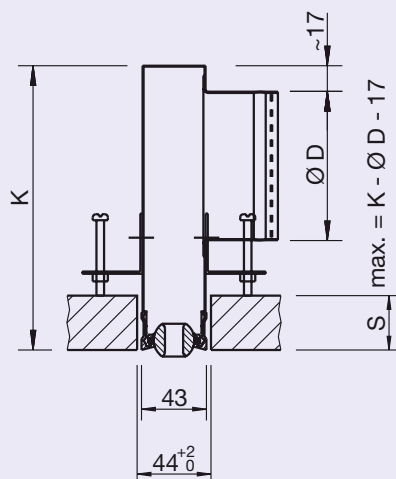


## Installation in a ceiling recess


Ball diffuser rows in offset arrangement

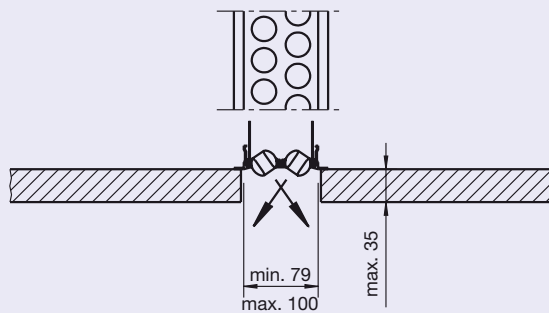

## Installation over open grid ceiling

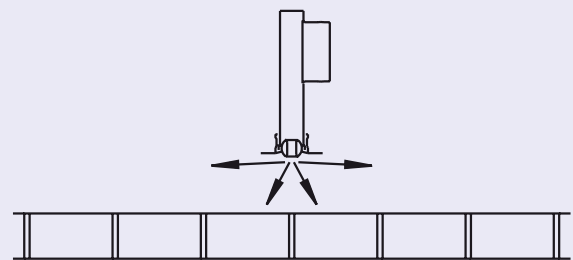


## Installation between protruding ceiling elements

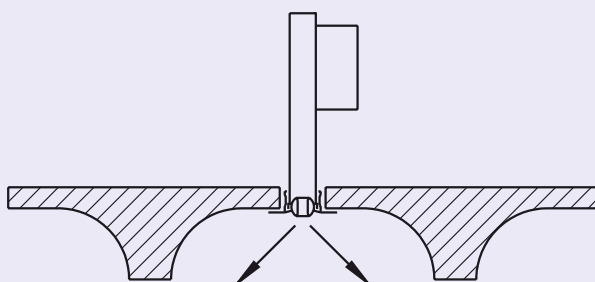


## KS1 special



## Installation flush with lower edge of grid ceiling

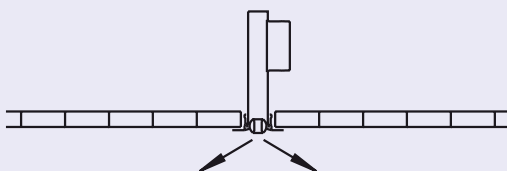


## Installation in lighting fixtures

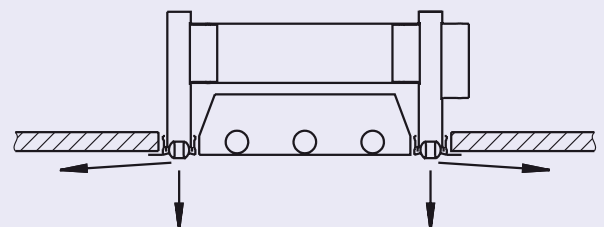

# Quick selection


## Type KS1

### Position 1




Dimension [mm]	A <sub>eff</sub> [m²]	q <sub>v</sub> [l/s,m]	8.3	11.1	13.9 nominal	16.7	19.4	22.2	25.0							
		Ḃ [m³/h,m]	30	40	50	60	70	80	90							
KS1_pos1	0.0034	Δp <sub>t</sub> [Pa]	11	19	29	41	55	71	90							
		L <sub>wA</sub> [dB(A)]	<20	21	26	31	35	38	41							
		L <sub>0.5</sub> /L <sub>0.3</sub> [m]	-	-	-	1.5	1.5	1.6	1.5	1.8	1.6	2.0	1.7	2.3	1.8	2.6
		v̄ <sub>H1</sub> [m/s]				0.13	0.15	0.14	0.18	0.17	0.21	0.19	0.25	0.22	0.29	0.26
Distance	A	[m]				2.7	2.7	2.8	2.7	3.0	2.8	3.2	2.9	3.5	3.0	3.8

### Position 2



Dimension [mm]	A <sub>eff</sub> [m²]	q <sub>v</sub> [l/s,m]	8.3	11.1	13.9	16.7 nominal	19.4	22.2	25.0							
		Ḃ [m³/h,m]	30	40	50	60	70	80	90							
KS1_pos2	0.0028	Δp <sub>t</sub> [Pa]	13	23	36	52	71	93	118							
		L <sub>wA</sub> [dB(A)]	<20	25	30	35	39	42	45							
		L <sub>0.5</sub> /L <sub>0.3</sub> [m]	-	-	-	1.5	1.5	1.6	1.5	1.7	1.6	1.9	1.7	2.2	1.8	2.4
		v̄ <sub>H1</sub> [m/s]				<0.10	<0.10	<0.10	0.11	0.11	0.13	0.13	0.16	0.15	0.19	0.17
Distance	A	[m]				2.7	2.7	2.8	2.7	2.9	2.8	3.1	2.9	3.4	3.0	3.6

### Position 3



Dimension [mm]	A <sub>eff</sub> [m²]	q <sub>v</sub> [l/s,m]	8.3	11.1	13.9	16.7 nominal	19.4	22.2	25.0							
		Ḃ [m³/h,m]	30	40	50	60	70	80	90							
KS1_pos3	0.0028	Δp <sub>t</sub> [Pa]	13	23	36	52	71	93	118							
		L <sub>wA</sub> [dB(A)]	<20	25	30	35	39	42	45							
		L <sub>0.5</sub> /L <sub>0.3</sub> [m]	-	-	-	1.5	-	1.5	1.5	1.7	1.5	1.9	1.6	2.1	1.8	2.3
		v̄ <sub>H1</sub> [m/s]				<0.10		0.10	0.12	0.12	0.15	0.14	0.18	0.16	0.21	0.19
Distance	A	[m]				2.7		2.7	2.7	2.9	2.7	3.1	2.8	3.3	3.0	3.5

### Positions 6 + 7




Dimension [mm]	A <sub>eff</sub> [m²]	q <sub>v</sub> [l/s,m]	8.3	11.1	13.9 nominal	16.7	19.4	22.2	25.0							
		Ḃ [m³/h,m]	30	40	50	60	70	80	90							
KS1 pos 6 + 7	0.0017	Δp <sub>t</sub> [Pa]	25	43	67	96	129	168	212							
		L <sub>wA</sub> [dB(A)]	23	30	35	40	43	47	49							
		L <sub>0.5</sub> /L <sub>0.3</sub> [m]	-	-	-	1.6	1.5	1.7	1.5	1.8	1.6	2.0	1.7	2.2	1.8	2.5
		v̄ <sub>H1</sub> [m/s]				0.11	0.14	0.14	0.17	0.16	0.20	0.18	0.24	0.21	0.27	0.23
Distance	A	[m]				2.8	2.7	2.9	2.7	3.0	2.8	3.2	2.9	3.4	3.0	3.7

# Quick selection


## Type KS2

### Position 1



Dimension [mm]	A <sub>eff</sub> [m <sup>2</sup> ]	q <sub>v</sub> [l/s,m]	13.9	16.7	19.4 nominal	22.2	25.0	27.8	30.6	33.3								
		Ḃ [m <sup>3</sup> /h,m]	50	60	70	80	90	100	110	120								
KS2_pos1	0.0067	Δp <sub>t</sub> [Pa]	9	12	16	21	27	33	40	47								
		L <sub>wA</sub> [dB(A)]	<20	<20	23	26	29	32	34	36								
		L <sub>0,5</sub> /L <sub>0,3</sub> [m]	1.6	1.7	1.6	1.9	1.6	2.1	1.7	2.3	1.8	2.5	2.0	2.7	2.1	3.0	2.2	3.2
		v̄ <sub>H1</sub> [m/s]	0.16	0.15	0.18	0.17	0.20	0.19	0.23	0.21	0.26	0.23	0.29	0.25	0.31	0.27	0.34	0.29
Distance	A	[m]	2.8	2.9	2.8	3.1	2.8	3.3	2.9	3.5	3.0	3.7	3.2	3.9	3.3	4.2	3.4	4.4

### Position 2



Dimension [mm]	A <sub>eff</sub> [m <sup>2</sup> ]	q <sub>v</sub> [l/s,m]	13.9	16.7	19.4	22.2	25.0	27.8 nominal	30.6	33.3								
		Ḃ [m <sup>3</sup> /h,m]	50	60	70	80	90	100	110	120								
KS2_pos2	0.0057	Δp <sub>t</sub> [Pa]	10	14	19	25	32	39	48	57								
		L <sub>wA</sub> [dB(A)]	<20	21	25	29	32	34	37	39								
		L <sub>0,5</sub> /L <sub>0,3</sub> [m]	-	1.7	1.6	1.8	1.6	1.9	1.7	2.1	1.8	2.2	1.9	2.4	2.0	2.6	2.1	2.7
		v̄ <sub>H1</sub> [m/s]	<0.10	0.10	0.10	0.12	0.11	0.13	0.12	0.15	0.14	0.17	0.15	0.19	0.17	0.21	0.19	
Distance	A	[m]		2.9	2.8	3.0	2.8	3.1	2.9	3.3	3.0	3.4	3.1	3.6	3.2	3.8	3.3	3.9

### Position 3



Dimension [mm]	A <sub>eff</sub> [m <sup>2</sup> ]	q <sub>v</sub> [l/s,m]	13.9	16.7	19.4	22.2	25.0 nominal	27.8	30.6	33.3								
		Ḃ [m <sup>3</sup> /h,m]	50	60	70	80	90	100	110	120								
KS2_pos3	0.0057	Δp <sub>t</sub> [Pa]	10	14	19	25	32	39	48	57								
		L <sub>wA</sub> [dB(A)]	<20	21	25	29	32	34	37	39								
		L <sub>0,5</sub> /L <sub>0,3</sub> [m]	-	1.6	-	1.7	1.6	1.8	1.6	1.9	1.7	2.1	1.8	2.2	1.9	2.4	2.0	2.6
		v̄ <sub>H1</sub> [m/s]	0.10	0.11	0.13	0.12	0.15	0.14	0.17	0.15	0.19	0.17	0.21	0.19	0.23	0.21		
Distance	A	[m]		2.8		2.9	2.8	3.0	2.8	3.1	2.9	3.3	3.0	3.4	3.1	3.6	3.2	3.8

### Positions 6 + 7



Dimension [mm]	A <sub>eff</sub> [m <sup>2</sup> ]	q <sub>v</sub> [l/s,m]	13.9	16.7	19.4 nominal	22.2	25.0	27.8	30.6	33.3								
		Ḃ [m <sup>3</sup> /h,m]	50	60	70	80	90	100	110	120								
KS2 pos 6 + 7	0.0035	Δp <sub>t</sub> [Pa]	18	26	35	46	57	71	85	101								
		L <sub>wA</sub> [dB(A)]	21	25	29	32	35	38	40	42								
		L <sub>0,5</sub> /L <sub>0,3</sub> [m]	-	1.8	1.7	1.9	1.7	2.0	1.8	2.2	1.9	2.4	2.0	2.6	2.2	2.9	2.3	3.1
		v̄ <sub>H1</sub> [m/s]	0.12	0.14	0.14	0.17	0.16	0.20	0.18	0.23	0.20	0.26	0.22	0.29	0.24	0.32	0.26	
Distance	A	[m]		3.0	2.9	3.1	2.9	3.2	3.0	3.4	3.1	3.6	3.2	3.8	3.4	4.1	3.5	4.3

# Quick selection

## Type KS2WK100



### Position 6



Dimension	$A_{eff}$	$\dot{q}_v$ [l/s,m]	13.9	16.7	19.4	22.2	25.0 nominal 90		27.8	30.6	33.3						
[mm]	[m <sup>2</sup> ]	$\dot{V}$ [m <sup>3</sup> /h,m]	50	60	70	80			100	110	120						
KS2WK100 pos6	0.0063	$\Delta p_t$ [Pa]	9	13	17	22	28		34	41	49						
		$L_{wA}$ [dB(A)]	<20	<20	23	26	29		31	33	35						
		$L_{0.5}/L_{0.3}$ [m]	-	-	1.8	1.8	1.9	1.7	2.0	1.8	2.2	1.9	2.4	2.0	2.6	2.1	2.9
		$\bar{v}_{H1}$ [m/s]			0.12	0.15	0.14	0.18	0.16	0.21	0.18	0.24	0.21	0.27	0.23	0.30	0.25
Distance	A	[m]			3.0	3.0	3.1	2.9	3.2	3.0	3.4	3.1	3.6	3.2	3.8	3.3	4.1

**Base to  $\bar{v}_{H1}$ :** room height H = 2.9 m  
 height of occupied zone = 1.7 m  
 $H_1$  = 1.2 m  
 distance A look table  
 difference of temperature = -8.0 K

# Definitions

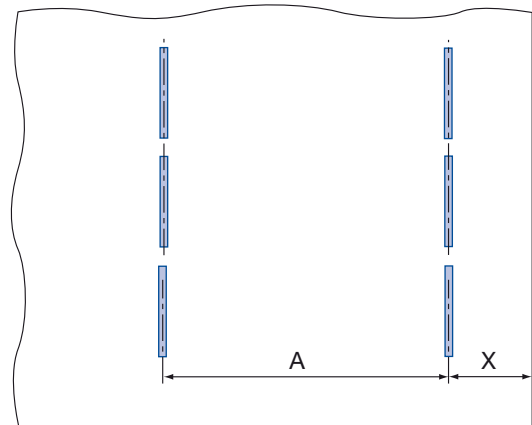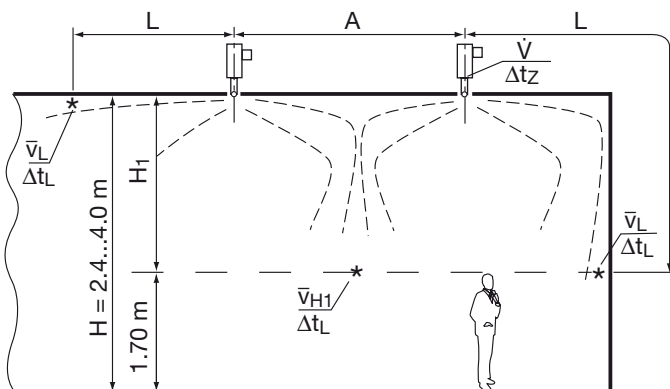


$L$	m	Distance $(X + H_1)$ blowing against the wall
$L_{0.5}/L_{0.3}$	m	Distance in relation to the final velocities 0.3 m/s or 0.5 m/s
$\dot{q}_v$	l/s	Volume flow rate per diffuser
$\dot{V}$	m <sup>3</sup> /h	Volume flow rate per diffuser
$\dot{V}_{\text{nominal}}$	m <sup>3</sup> /h	Nominal volume flow rate with VAV: $V_{\text{max}} = 1.19 \cdot \dot{V}_{\text{nominal}}$
$v_{\text{eff}}$	m/s	Eff. discharge velocity
$A$	m	Distance between the axes of two diffusers
$X$	m	Distance between diffuser centre and wall
$H$	m	Room height
$H_1$	m	Distance between ceiling and occupied zone
$\bar{v}_{H_1}$	m/s	Mean flow velocity of room air between two diffusers in ceiling distance $H_1$
$\bar{v}_L$	m/s	Mean flow velocity of room air between wall in ceiling distance $H_1$
$t_R$	°C	Room air temperature
$t_L$	°C	Jet air temperature
$\Delta t_z$	K	Difference between room air and supply air temperature
$\Delta t_L$	K	Difference between room air and jet air temperature at distance $L = A/2 + H_1$ $L = X + H_1$
$A_{\text{eff}}$	m <sup>2</sup>	Effective air outlet surface area
$\Delta p_t$	Pa	Total pressure drop (supply air)
$L_{wA}$	dB(A)	A-weighted sound power level
$L_{wNC}$		NC rating of sound power level $L_{wNC} = L_{wA} - 6 \text{ dB}$
$L_{wNR}$		$L_{wNR} = L_{wNC} + 2 \text{ dB}$
$L_{pA}, L_{pNC}$		A-weighting or NC curve respectively of room sound power level $L_{pA} \sim L_{wA} - 8 \text{ dB}$ $L_{pNC} \sim L_{wNC} - 8 \text{ dB}$
$L_{\text{wokt}}$	dB	Sound power level in the octave-centre frequencies
$\Delta L$	dB	Insertion attenuation in the octave-centre frequencies
$\Delta L_A$	dB	Octave-centre frequencies, correction value
$f$	Hz	Octave-centre frequencies
FW0066		Fixed resistance: plenum box without perforated plate, spigot 66%

# Technical Data

## Type KS1

### Position 1



### Correction table, octave-centre frequencies


f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta LA$	-5	+6	-1	-9	-18	<-20	<-20	[dB]

### Insertion attenuation (incl. end reflection) Interior of box not insulated


f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta L$	24	17	15	15	16	22	22	[dB]

### Room air velocity Isotherm

$\bar{v}_{H1}$

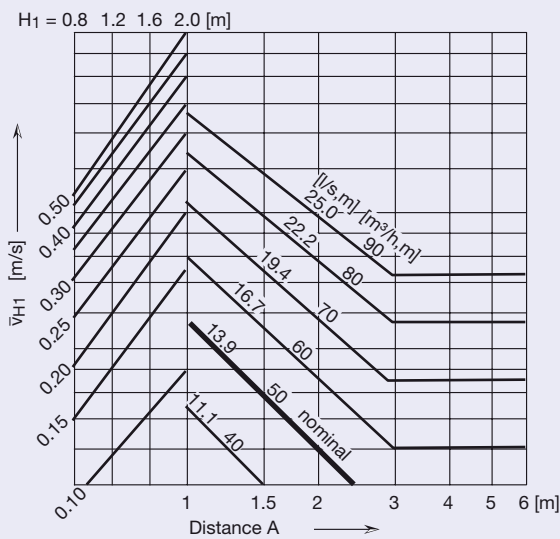


### Temperature quotient $\Delta t_L / \Delta t_z$

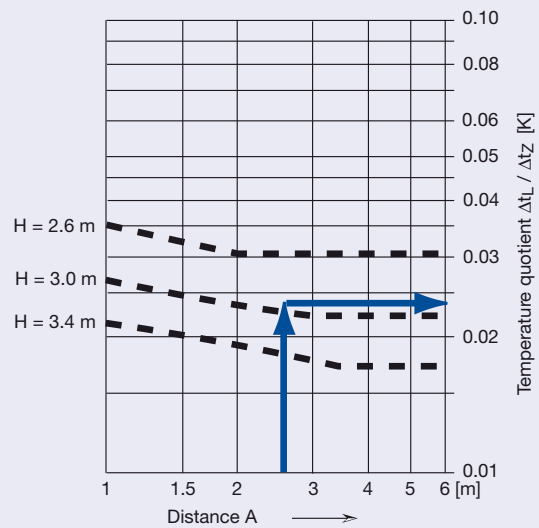


### Room air velocity $\Delta t_z = -8 K$

$\bar{v}_{H1}$

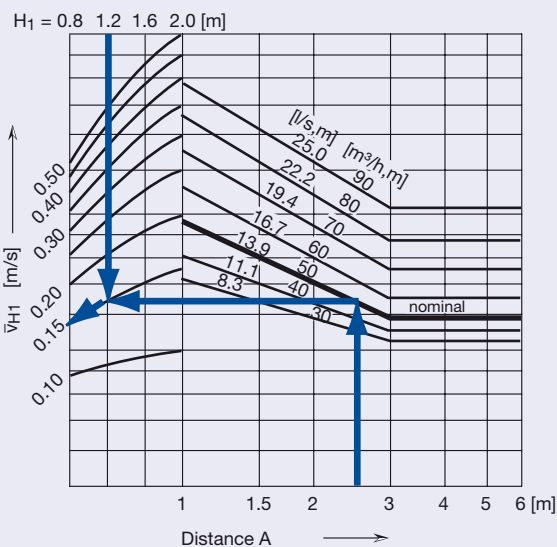


### Room air velocity $\Delta t_z = -12 K$

$\bar{v}_{H1}$

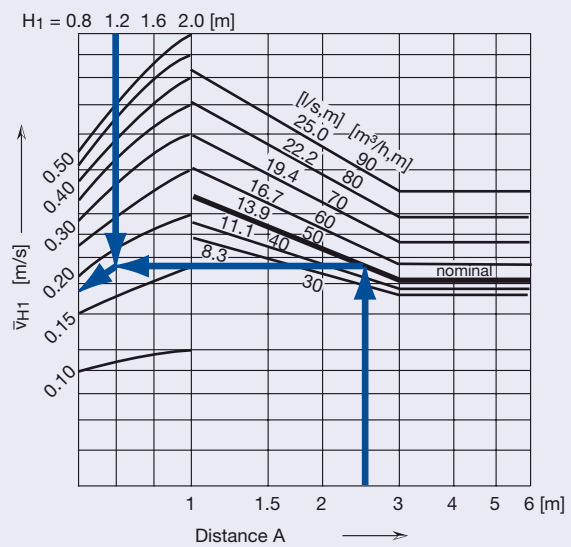


## Type KS1

### Position 1




Eff. air outlet surface area

$$A_{\text{eff}} = 0.0034 \text{ m}^2$$



### Sound power level and pressure drop

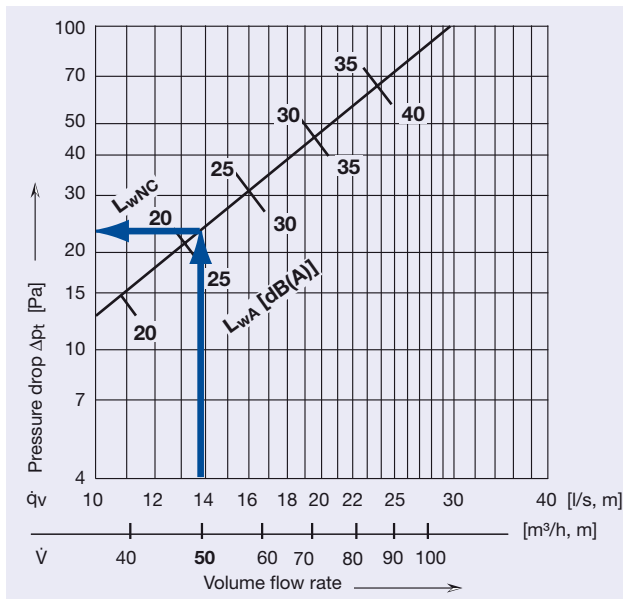

Correction of the sound power level  $L_{wA}$  and the pressure drop  $\Delta p_t$

Spigot	Length [mm]					
	1000		1500		2000	
$\varnothing$ [mm]	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -
1x 80	0	1	+5	1.6	+8	2.5
1x100	-4	0.7	+2	1.0	+6	1.4
1x125	-5	0.6	0	0.8	+5	1.0
2x 80	-6	0.6	-1	0.8	+3	1.0
2x100	-8	0.5	-4	0.6	-1	0.7
2x125	-8	0.5	-5	0.6	-2	0.6

### Example

#### Given

Type KS1...K190 (FW0066) pos. 1	1 x $\varnothing$ 80 mm	$\dot{q}_v$
Volume flow rate	13.9 l/s, m	$\dot{V}$
	50 m <sup>3</sup> /h, m	H
Room height	2.9 m	H
Occupied zone height	1.7 m	H <sub>1</sub>
Distance to the ceiling	1.2 m	A
Distance between diffusers	2.5 m	$\Delta t$
Difference of temperature	- 12 K / - 8 K / 0 K	

#### Solution

Sound power level	26 dB(A)	$L_{wA}$
Limite curve	21	$L_{wNC}$
Pressure drop	24 Pa	$\Delta p_t$

### Octave spectrum

f	125	250	500	1000	2000	4000	8000	[Hz]
$L_{wA}$	26	26	26	26	26	26	26	[dB(A)]
$\Delta L_A$	-5	+6	-1	-9	-18	<-20	<-20	[dB]
$L_{wOkt}$	21	32	25	17	<15	<15	<15	[dB]

### Insertion attenuation see p. 12

Room air velocity 1.7 m over ground


at - 12 K	=	0.18 m/s	$\bar{v}_{H1}$
at - 8 K	=	0.15 m/s	$\bar{v}_{H1}$
at Isotherm	=	<0.10 m/s	$\bar{v}_{H1}$

Difference of temperature	0.024	$\Delta t_L / \Delta t_z$
$(t_R - t_L)$ at $\Delta t_L - 8 \text{ K} = 0.024 \times 8 =$	$\sim 0.2 \text{ K}$	$\Delta t_L$

# Technical Data

## Type KS1

### Position 2



### Correction table, octave-centre frequencies


f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta LA$	-5	+6	-1	-9	-18	<-20	<-20	[dB]

### Insertion attenuation (incl. end reflection) Interior of box not insulated

f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta L$	24	17	15	15	16	22	22	[dB]


### Room air velocity Isotherm

$\bar{v}_{H1}$

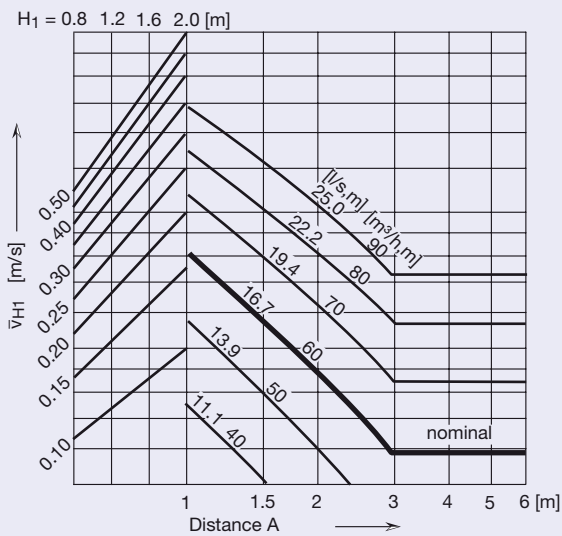


### Temperature quotient

$\Delta t_L / \Delta t_z$

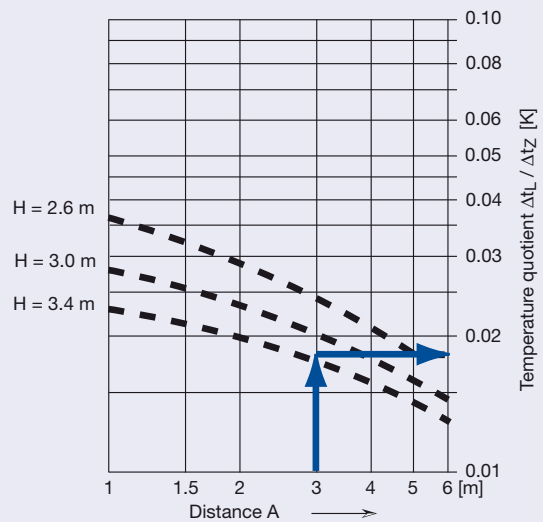


### Room air velocity $\Delta t_z = -8 K$

$\bar{v}_{H1}$

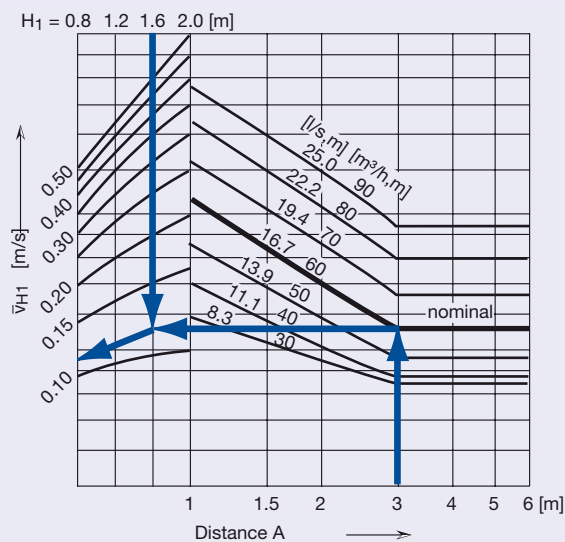


### Room air velocity $\Delta t_z = -12 K$

$\bar{v}_{H1}$

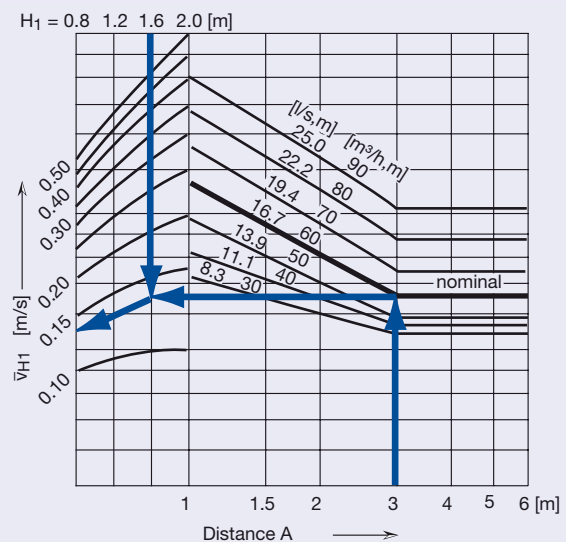


## Type KS1

### Position 2




### Sound power level and pressure drop

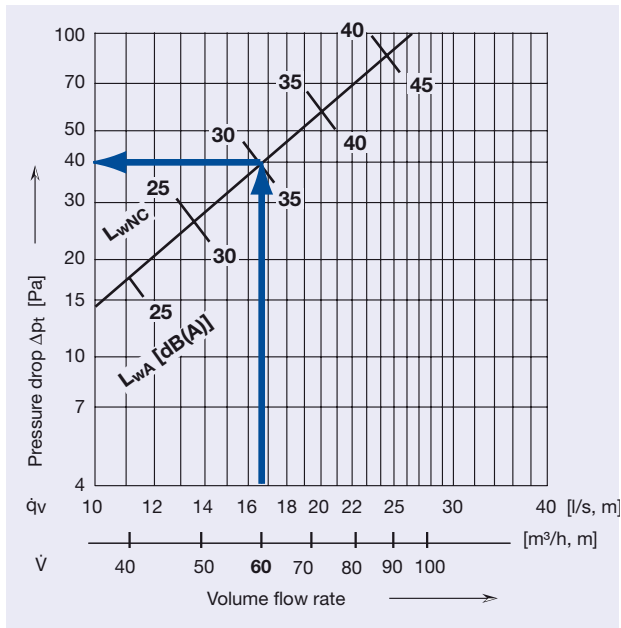

### Eff. air outlet surface area

$$A_{\text{eff}} = 0.0028 \text{ m}^2$$



### Correction of the sound power level $L_{wA}$ and the pressure drop $\Delta p_t$

Spigot	Length [mm]					
	1000		1500		2000	
$\varnothing$ [mm]	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -
1x 80	0	1	+5	1.6	+8	2.4
1x100	-1	0.8	+3	1.1	+7	1.4
1x125	-1	0.7	+3	0.8	+7	1.0
2x 80	-3	0.6	0	0.8	+3	1.0
2x100	-4	0.6	-1	0.6	+2	0.8
2x125	-4	0.5	-1	0.6	+2	0.8

### Example

#### Given

Type KS1...K190 (FW0066) pos. 2	1 x $\varnothing$ 80 mm	
Volume flow rate	16.7 l/s, m	$\dot{q}_v$
	60 m³/h, m	$\dot{V}$
Room height	3.3 m	H
Occupied zone height	1.7 m	
Distance to the ceiling	1.6 m	$H_1$
Distance between diffusers	3.0 m	A
Difference of temperature	- 12 K / - 8 K / 0 K	$\Delta t$

#### Solution

Sound power level	35 dB(A)	$L_{wA}$
Limite curve	30	$L_{wNC}$
Pressure drop	24 Pa	$\Delta p_t$

### Octave spectrum

f	125	250	500	1000	2000	4000	8000	[Hz]
$L_{wA}$	35	35	35	35	35	35	35	[dB(A)]
$\Delta L_A$	-5	+6	-1	-9	-18	<-20	<-20	[dB]
$L_{wOkt}$	30	41	34	26	17	<15	<15	[dB]


### Insertion attenuation see p. 14

Room air velocity 1.7 m over ground		
at - 12 K	=	0.14 m/s $\bar{v}_{H1}$
at - 8 K	=	0.12 m/s $\bar{v}_{H1}$
at Isotherm	=	<0.10 m/s $\bar{v}_{H1}$
Difference of temperature		0.018 $\Delta t_L / \Delta t_z$
$(t_R - t_L)$ at $\Delta t_L - 8 \text{ K} = 0.018 \times 8 =$		$\sim 0.2 \text{ K}$ $\Delta t_L$

# Technical Data

## Type KS1

### Position 3



### Correction table, octave-centre frequencies

f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta LA$	-5	+6	-1	-9	-18	<-20	<-20	[dB]

### Insertion attenuation (incl. end reflection)


Interior of box not insulated

f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta L$	24	17	15	15	16	22	22	[dB]

### Room air velocity


#### Isotherm

$\bar{v}_{H1}$

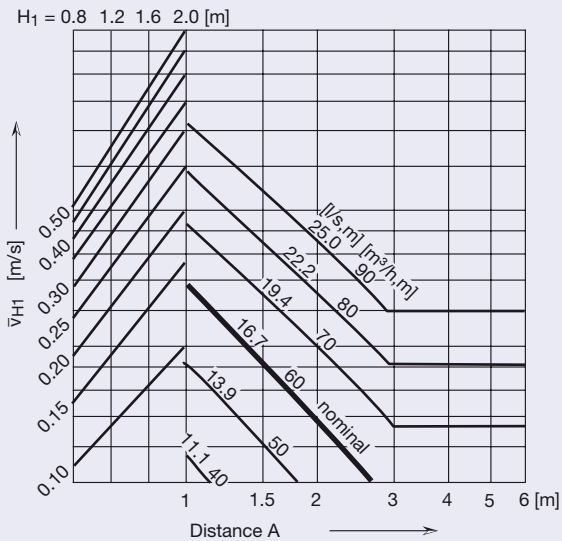

### Temperature quotient


$\Delta t_L / \Delta t_Z$

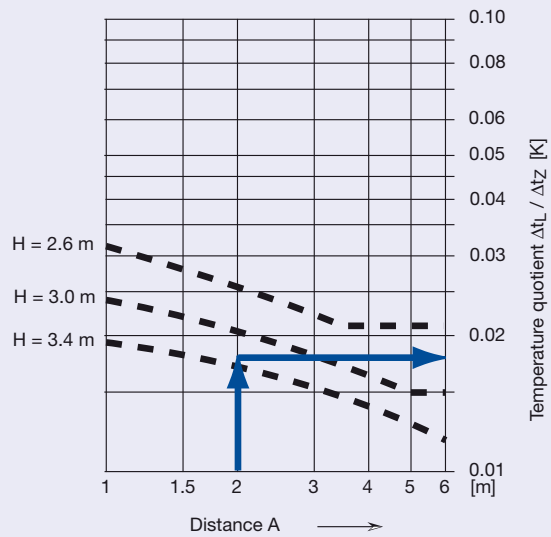

### Room air velocity

$\Delta t_Z = -8 \text{ K}$


$\bar{v}_{H1}$

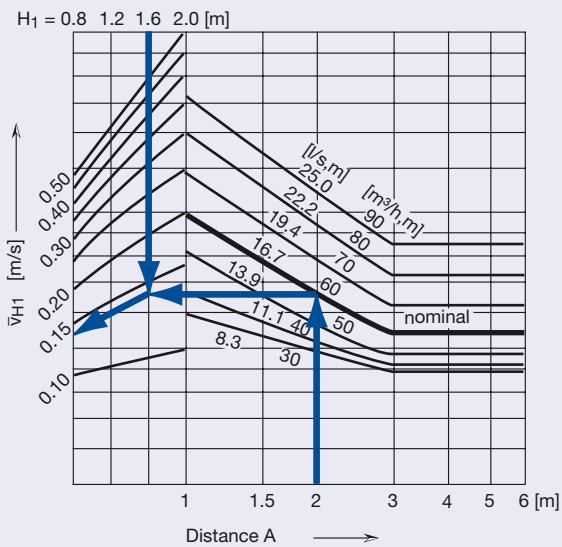

### Room air velocity


$\Delta t_Z = -12 \text{ K}$

$\bar{v}_{H1}$

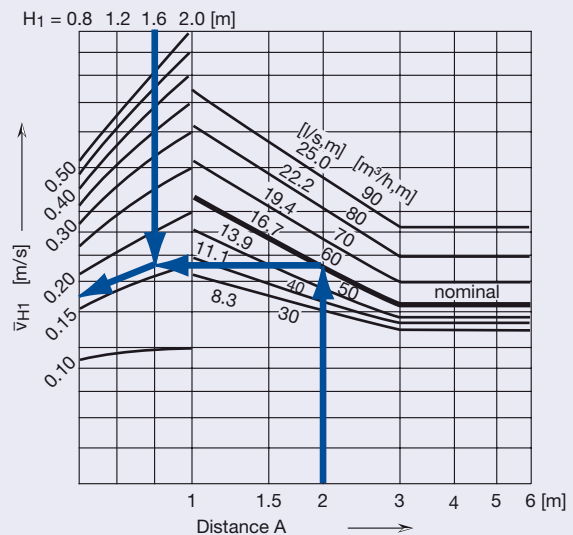


## Type KS1

### Position 3




Eff. air outlet surface area

$$A_{\text{eff}} = 0.0028 \text{ m}^2$$



### Sound power level and pressure drop

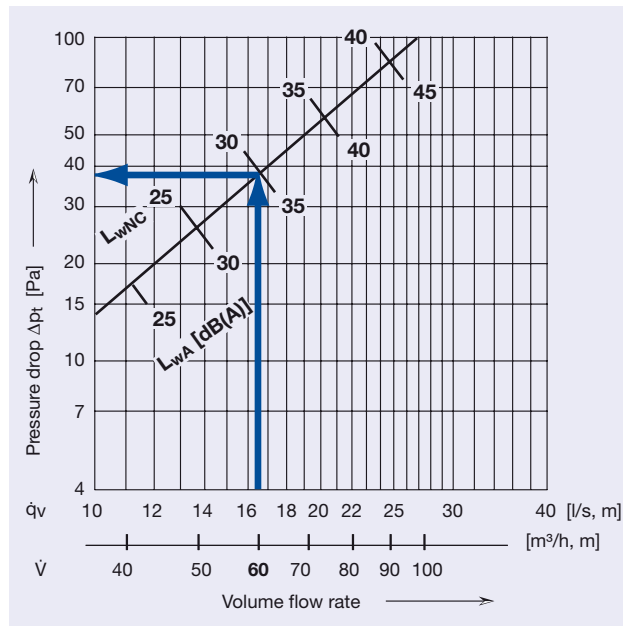

Correction of the sound power level  $L_{wA}$  and the pressure drop  $\Delta p_t$

Spigot	Length [mm]					
	1000		1500		2000	
$\varnothing$ [mm]	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -
1 × 80	0	1	+5	1.6	+8	2.4
1 × 100	-1	0.8	+3	1.1	+7	1.4
1 × 125	-1	0.7	+3	0.8	+7	1.0
2 × 80	-3	0.6	0	0.8	+3	1.0
2 × 100	-4	0.6	-1	0.6	+2	0.8
2 × 125	-4	0.5	-1	0.6	+2	0.8

### Example

#### Given

Type KS1...K190 (FW0066) pos. 3	1 × $\varnothing$ 80 mm	
Volume flow rate	16.7 l/s, m	$\dot{q}_v$
	60 m³/h, m	$\dot{V}$
Room height	3.3 m	H
Occupied zone height	1.7 m	
Distance to the ceiling	1.6 m	$H_1$
Distance between diffusers	2.0 m	A
Difference of temperature	- 12 K / - 8 K / 0 K	$\Delta t$

#### Solution

Sound power level	35 dB(A)	$L_{wA}$
Limite curve	30	$L_{wNC}$
Pressure drop	39 Pa	$\Delta p_t$

### Octave spectrum

f	125	250	500	1000	2000	4000	8000	[Hz]
$L_{wA}$	35	35	35	35	35	35	35	[dB(A)]
$\Delta L_A$	-5	+6	-1	-9	-18	<-20	<-20	[dB]
$L_{wOkt}$	39	41	34	26	17	<15	<15	[dB]


### Insertion attenuation see p. 16

Room air velocity 1.7 m over ground		
at - 12 K	=	0.17 m/s $\bar{v}_{H1}$
at - 8 K	=	0.14 m/s $\bar{v}_{H1}$
at Isotherm	=	<0.10 m/s $\bar{v}_{H1}$
Difference of temperature		0.018 $\Delta t_L / \Delta t_z$
$(t_R - t_L)$ at $\Delta t_L - 8 \text{ K} = 0.018 \times 8 =$		$\sim 0.2 \text{ K}$ $\Delta t_L$

# Technical Data

## Type KS1

Positions 6 + 7




Correction table, octave-centre frequencies

f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta LA$	-5	+6	-1	-9	-18	<-20	<-20	[dB]


Insertion attenuation (incl. end reflection)  
Interior of box not insulated

f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta L$	24	17	15	15	16	22	22	[dB]


Room air velocity  $\bar{v}_{H1}$   
Isotherm

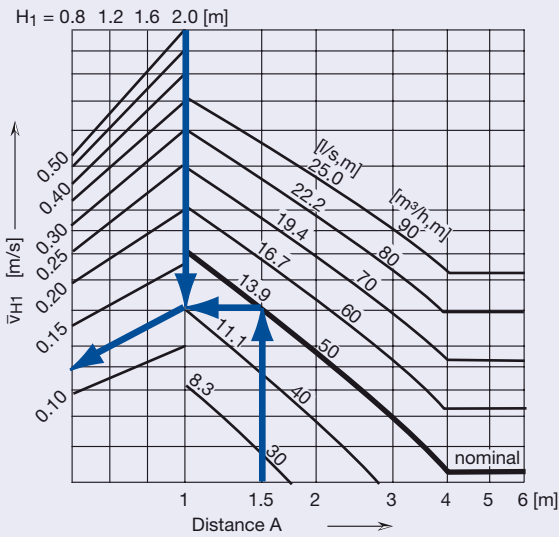


Room air velocity by the wall  $\bar{v}_L$   
 $\Delta t_z = -8 K$

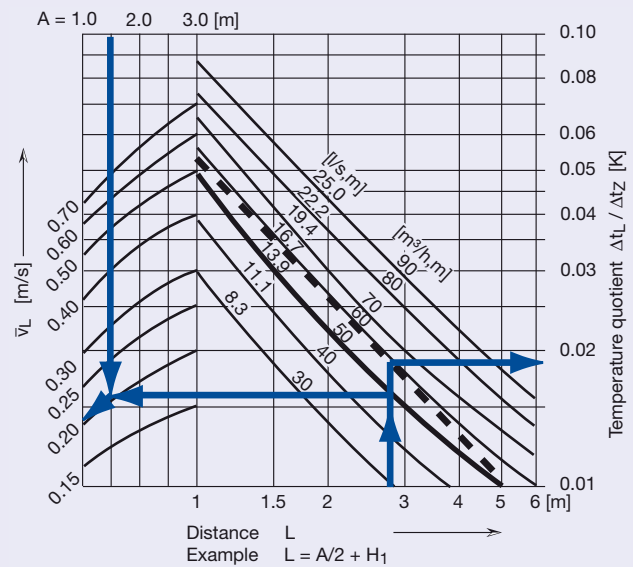

Room air velocity  $\bar{v}_{H1}$   
 $\Delta t_z = -8 K$

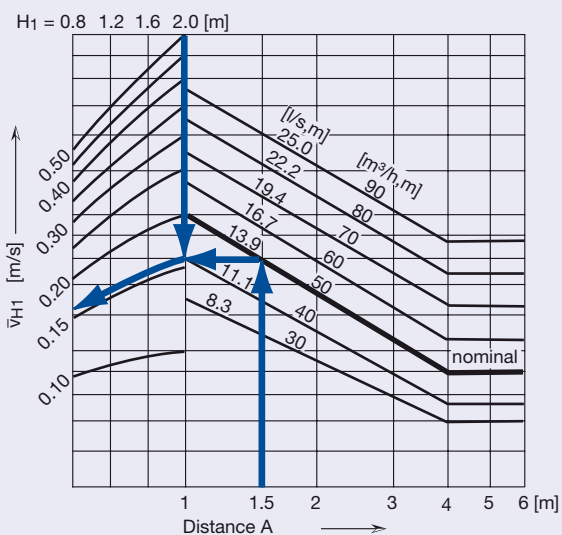


Room air velocity  $\bar{v}_{H1}$   
 $\Delta t_z = -12 K$

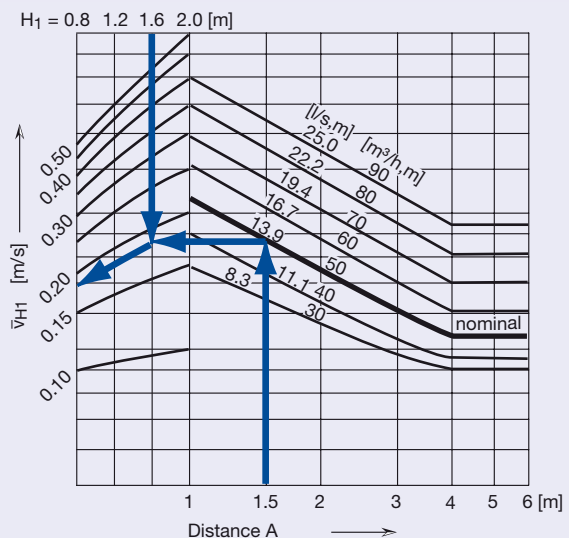


## Type KS1

Positions 6 + 7




Sound power level and pressure drop

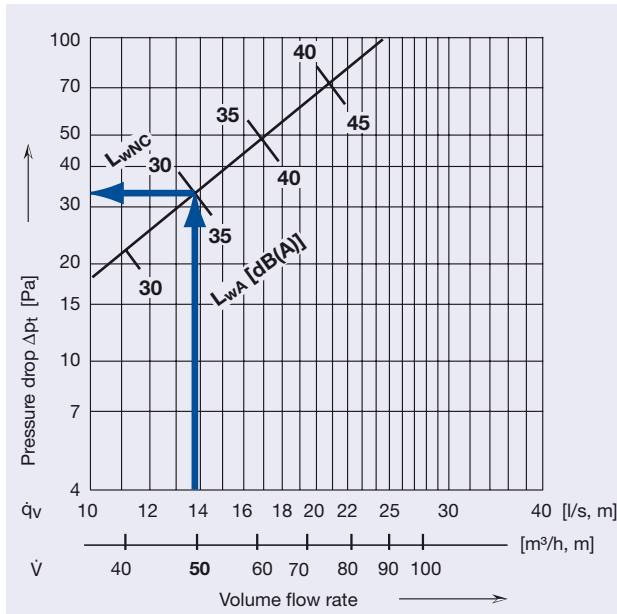

Eff. air outlet surface area

$$A_{\text{eff}} = 0.0017 \text{ m}^2$$



Correction of the sound power level  $L_{wA}$  and the pressure drop  $\Delta p_t$

Spigot	Length [mm]					
	1000		1500		2000	
$\varnothing$ [mm]	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -
1x 80	0	1	+4	1.5	+7	2.1
1x100	0	0.8	+4	1.1	+7	1.4
1x125	0	0.7	+3	0.9	+7	1.1
2x 80	-2	0.7	+1	0.8	+3	1.0
2x100	-2	0.6	0	0.7	+3	0.8
2x125	-2	0.6	0	0.7	+3	0.7

## Example

### Given

Type KS1...K190 (FW0066) pos. 6 + 7 1 x  $\varnothing$  80 mm  
 Volume flow rate 13.9 l/s, m  $\dot{q}_v$   
 50 m<sup>3</sup>/h, m  $\dot{V}$   
 Room height 3.7 m H  
 Occupied zone height 1.7 m  
 Distance to the ceiling 2.0 m  $H_1$   
 Distance between diffusers 1.5 m A  
 Difference of temperature - 12 K / - 8 K / 0 K  $\Delta t$

### Solution

Sound power level 35 dB(A)  $L_{wA}$   
 Limite curve 30  $L_{wNC}$   
 Pressure drop 33 Pa  $\Delta p_t$

## Octave spectrum

f	125	250	500	1000	2000	4000	8000	[Hz]
$L_{wA}$	35	35	35	35	35	35	35	[dB(A)]
$\Delta L_A$	-5	+6	-1	-9	-18	<-20	<-20	[dB]
$L_{wOkt}$	30	41	34	26	17	<15	<15	[dB]


## Insertion attenuation see p. 18

Room air velocity 1.7 m over ground  
 at - 12 K = 0.18 m/s  $\bar{v}_{H1}$   
 at - 8 K = 0.16 m/s  $\bar{v}_{H1}$   
 at Isotherm = 0.12 m/s  $\bar{v}_{H1}$   
 Difference of temperature 0.019  $\Delta t_L / \Delta t_z$   
 ( $t_R - t_L$ ) at  $\Delta t_L - 8 \text{ K} = 0.019 \times 8 = \sim 0.2 \text{ K}$   $\Delta t_L$

# Technical Data

## Type KS2

### Position 1



### Correction table, octave-centre frequencies


f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta LA$	-5	+6	-1	-9	-18	<-20	<-20	[dB]

### Insertion attenuation (incl. end reflection)


Interior of box not insulated

f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta L$	21	13	16	11	16	15	29	[dB]


### Room air velocity Isotherm

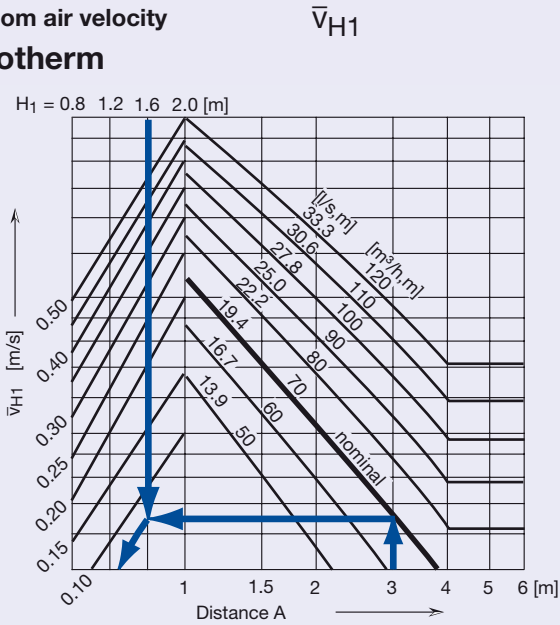


### Temperature quotient

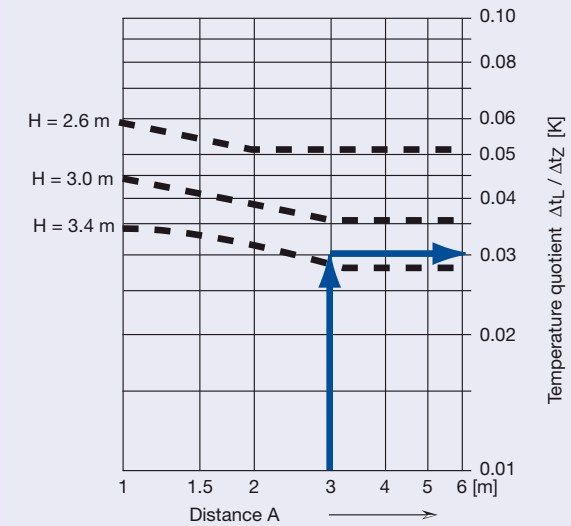

### Room air velocity $\Delta t_z = -8 \text{ K}$

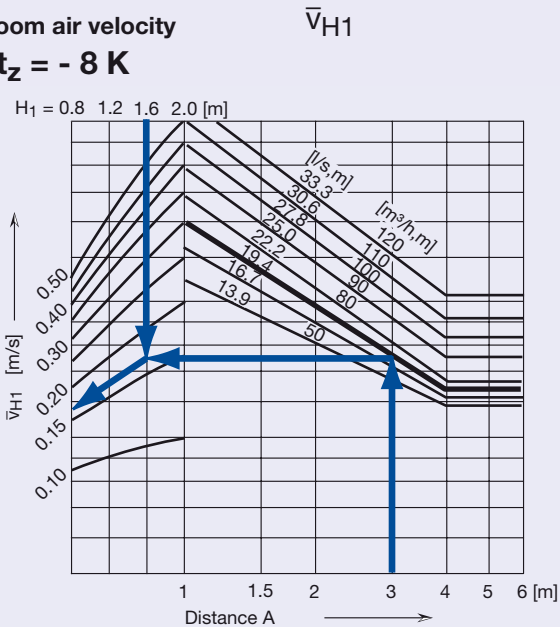


### Room air velocity $\Delta t_z = -12 \text{ K}$

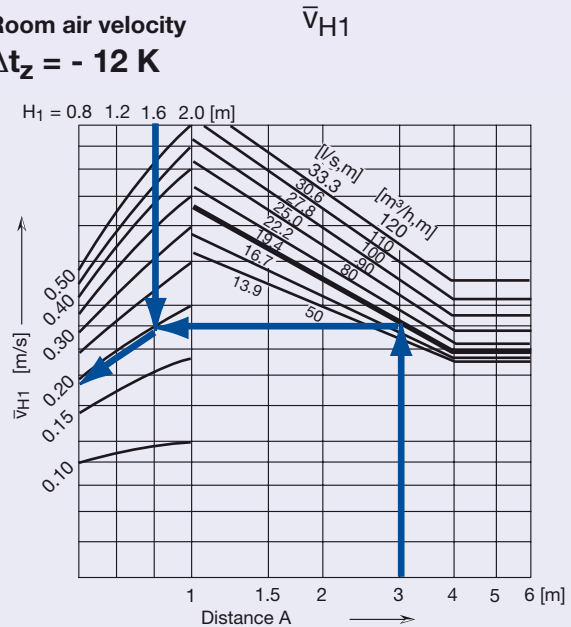


## Type KS2

### Position 1




### Sound power level and pressure drop

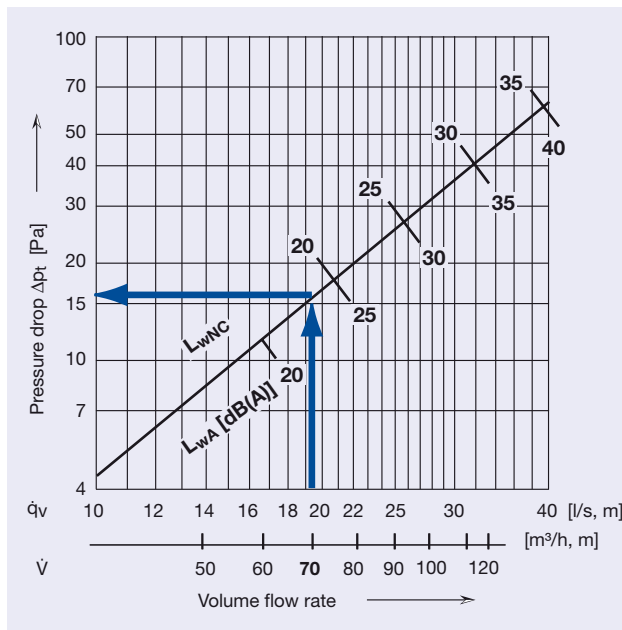

### Eff. air outlet surface area

$$A_{\text{eff}} = 0.0067 \text{ m}^2$$



### Correction of the sound power level $L_{wA}$ and the pressure drop $\Delta p_t$

Spigot $\varnothing$ [mm]	Length [mm]					
	1000		1500		2000	
	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -
1x 80	+9	1.8	+18	3.6	+25	6.1
1x100	0	1	+9	1.8	+17	2.8
1x125	-7	0.7	+2	1.0	+10	1.5
2x 80	-1	0.7	+6	1.2	+12	1.8
2x100	-9	0.5	-3	0.7	+3	1.0
2x125	-13	0.4	-8	0.5	-4	0.7

### Example

#### Given

Type KS2...K220 (FW0066) pos. 1	1 x $\varnothing$ 100 mm	
Volume flow rate	19.4 l/s, m	$\dot{q}_v$
	70 m <sup>3</sup> /h, m	$\dot{V}$
Room height	3.3 m	H
Occupied zone height	1.7 m	
Distance to the ceiling	1.6 m	$H_1$
Distance between diffusers	3.0 m	A
Difference of temperature	- 12 K / - 8 K / 0 K	$\Delta t$

#### Solution

Sound power level	23 dB(A)	$L_{wA}$
Limite curve	18	$L_{wNC}$
Pressure drop	16 Pa	$\Delta p_t$

### Octave spectrum

f	125	250	500	1000	2000	4000	8000	[Hz]
$L_{wA}$	23	23	23	23	23	23	23	[dB(A)]
$\Delta L_A$	-5	+6	-1	-9	-18	<-20	<-20	[dB]
$L_{wOkt}$	18	29	22	14	<14	<14	<14	[dB]

### Insertion attenuation see p. 20


Room air velocity 1.7 m over ground			
at - 12 K	=	0.19 m/s	$\bar{v}_{H1}$
at - 8 K	=	0.16 m/s	$\bar{v}_{H1}$
at Isotherm	=	<0.10 m/s	$\bar{v}_{H1}$

Difference of temperature	0.03	$\Delta t_L / \Delta t_z$
$(t_R - t_L)$ at $\Delta t_L - 8 \text{ K} = 0.03 \times 8 =$	$\sim 0.3 \text{ K}$	$\Delta t_L$

# Technical Data

## Type KS2

### Position 2



### Correction table, octave-centre frequencies


f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta LA$	-5	+6	-1	-9	-18	<-20	<-20	[dB]

### Insertion attenuation (incl. end reflection)


Interior of box not insulated

f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta L$	21	13	16	11	16	15	29	[dB]


### Room air velocity Isotherm

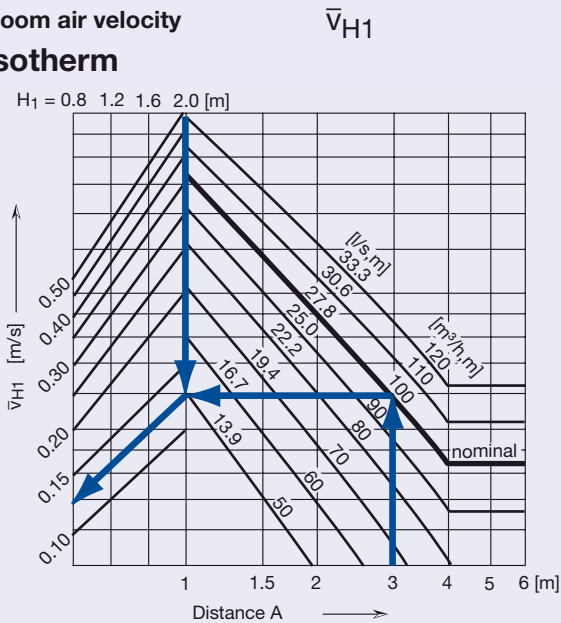


### Temperature quotient

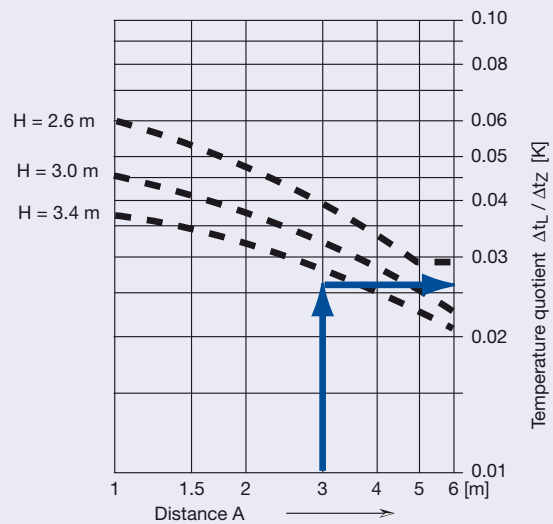

### Room air velocity $\Delta t_z = -8 \text{ K}$

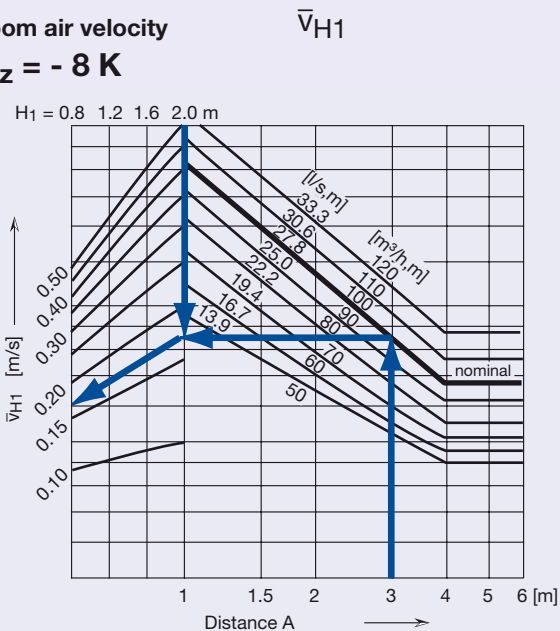


### Room air velocity $\Delta t_z = -12 \text{ K}$

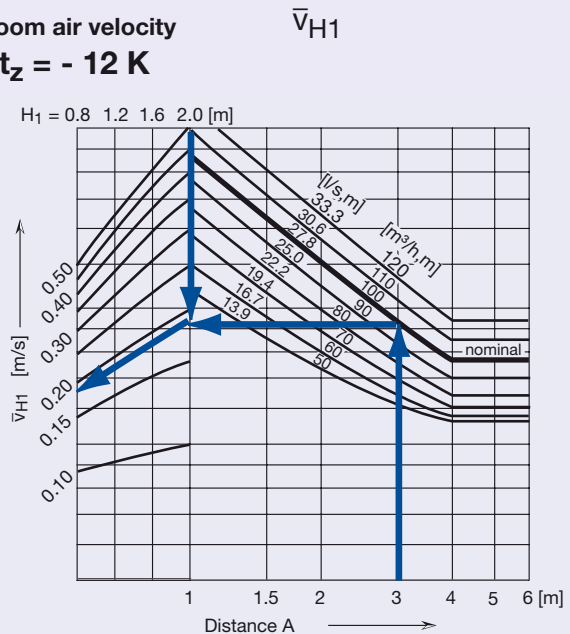


## Type KS2

### Position 2




### Sound power level and pressure drop

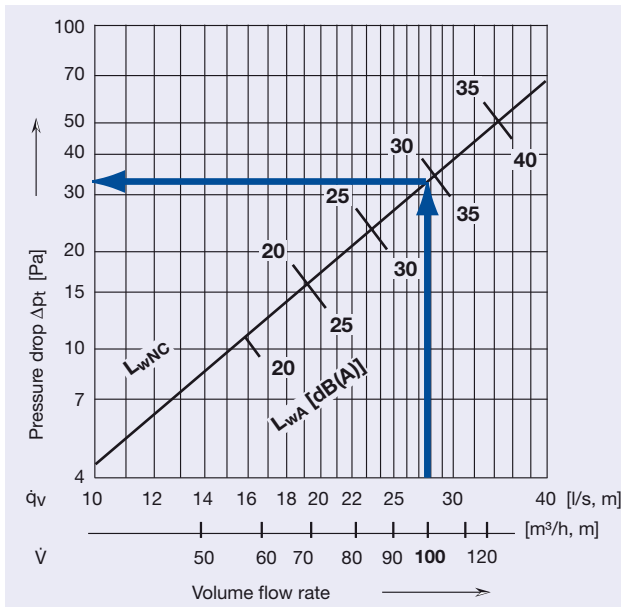

### Eff. air outlet surface area

$$A_{\text{eff}} = 0.0057 \text{ m}^2$$



### Correction of the sound power level $L_{wA}$ and the pressure drop $\Delta p_t$

Spigot	Length [mm]					
	1000		1500		2000	
$\varnothing$ [mm]	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -
1x 80	+7	1.7	+16	3.4	+23	5.6
1x100	0	1	+8	1.7	+15	2.7
1x125	-3	0.7	+4	1.0	+10	1.5
2x 80	-2	0.7	+5	1.2	+10	1.7
2x100	-6	0.5	-2	0.7	+3	1.0
2x125	-7	0.5	-3	0.6	0	0.7

### Example

#### Given

Type KS2...K220 (FW0066) pos. 2	1 x $\varnothing$ 100 mm
Volume flow rate	27.8 l/s, m $\dot{q}_v$ 100 m³/h, m $\dot{V}$
Room height	3.7 m H
Occupied zone height	1.7 m
Distance to the ceiling	2.0 m $H_1$
Distance between diffusers	3.0 m A
Difference of temperature	- 12 K / - 8 K / 0 K $\Delta t$

#### Solution

Sound power level	34 dB(A)	$L_{wA}$
Limite curve	29	$L_{wNC}$
Pressure drop	34 Pa	$\Delta p_t$

### Octave spectrum

f	125	250	500	1000	2000	4000	8000	[Hz]
$L_{wA}$	34	34	34	34	34	34	34	[dB(A)]
$\Delta L_A$	-5	+6	-1	-9	-18	<-20	<-20	[dB]
$L_{wOkt}$	29	40	33	25	16	<14	<14	[dB]

### Insertion attenuation see p. 22

Room air velocity 1.7 m over ground


at - 12 K	=	0.19 m/s	$\bar{v}_{H1}$
at - 8 K	=	0.17 m/s	$\bar{v}_{H1}$
at Isotherm	=	0.13 m/s	$\bar{v}_{H1}$

Difference of temperature	0.026	$\Delta t_L / \Delta t_z$
$(t_R - t_L)$ at $\Delta t_L - 8 \text{ K} = 0.026 \times 8 =$	$\sim 0.2 \text{ K}$	$\Delta t_L$

# Technical Data

## Type KS2

### Position 3



### Correction table, octave-centre frequencies


f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta LA$	-5	+6	-1	-9	-18	<-20	<-20	[dB]

### Insertion attenuation (incl. end reflection) Interior of box not insulated


f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta L$	21	13	16	11	16	15	29	[dB]

### Room air velocity Isotherm

$\bar{v}_{H1}$

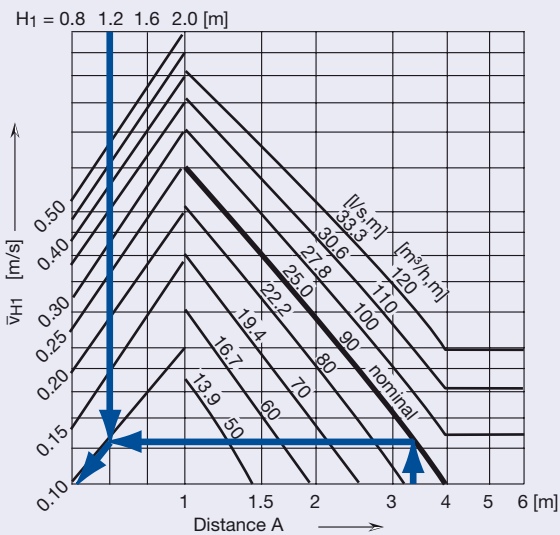


### Temperature quotient $\Delta t_L / \Delta t_z$

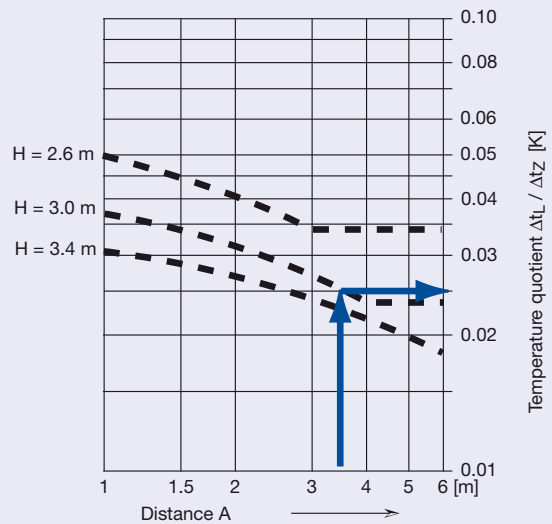


### Room air velocity $\Delta t_z = -8 K$

$\bar{v}_{H1}$

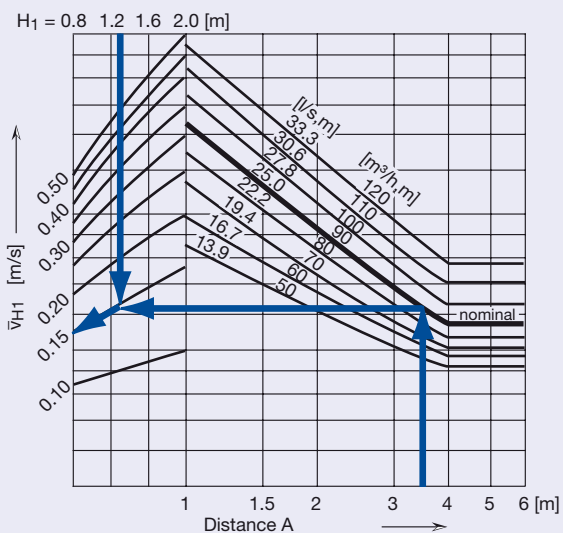


### Room air velocity $\Delta t_z = -12 K$

$\bar{v}_{H1}$

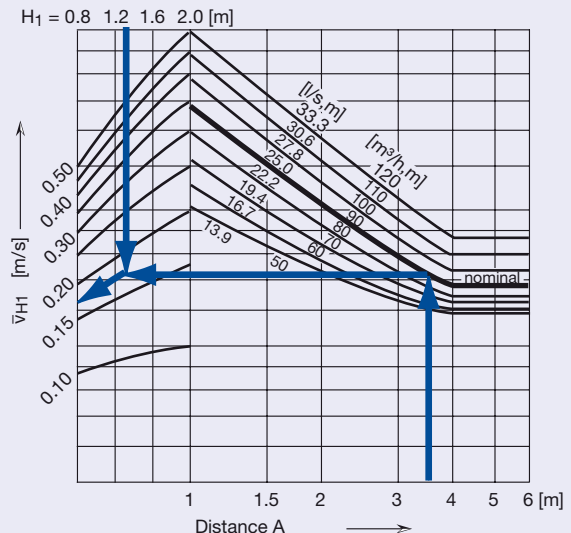


## Type KS2

### Position 3




Eff. air outlet surface area

$$A_{\text{eff}} = 0.0057 \text{ m}^2$$



### Sound power level and pressure drop

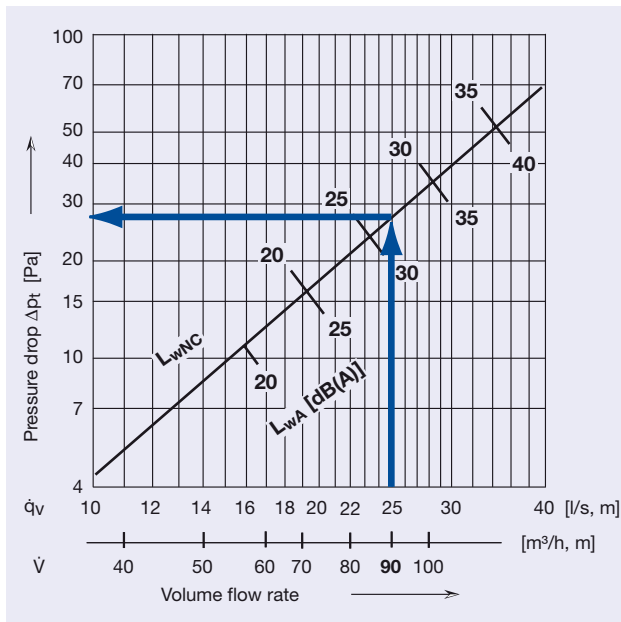

### Correction of the sound power level $L_{wA}$ and the pressure drop $\Delta p_t$

Spigot	Length [mm]					
	1000		1500		2000	
$\varnothing$ [mm]	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -
1x 80	+7	1.7	+16	3.4	+24	5.7
1x100	0	1	+8	1.7	+16	2.7
1x125	-3	0.7	+4	1.0	+10	1.5
2x 80	-2	0.7	+5	1.2	+10	1.7
2x100	-6	0.5	-2	0.7	+3	1.0
2x125	-7	0.5	-3	0.6	0	0.7

### Example

#### Given

Type KS2...K220 (FW0066) pos. 3 1 x  $\varnothing$  100 mm  
 Volume flow rate 25.0 l/s, m  $\dot{q}_v$   
 90  $\text{m}^3/\text{h}$ , m  $\dot{V}$   
 Room height 3.0 m H  
 Occupied zone height 1.7 m  
 Distance to the ceiling 1.3 m  $H_1$   
 Distance between diffusers 3.5 m A  
 Difference of temperature - 12 K / - 8 K / 0 K  $\Delta t$

#### Solution

Sound power level 31 dB(A)  $L_{wA}$   
 Limite curve 26  $L_{wNC}$   
 Pressure drop 28 Pa  $\Delta p_t$

### Octave spectrum

f	125	250	500	1000	2000	4000	8000	[Hz]
$L_{wA}$	31	31	31	31	31	31	31	[dB(A)]
$\Delta L_A$	-5	+6	-1	-9	-18	<-20	<-20	[dB]
$L_{wOkt}$	26	37	30	22	<15	<15	<15	[dB]

### Insertion attenuation see p. 24

Room air velocity 1.7 m over ground


at - 12 K = 0.17 m/s  $\bar{v}_{H1}$   
 at - 8 K = 0.15 m/s  $\bar{v}_{H1}$   
 at Isotherm = <0.10 m/s  $\bar{v}_{H1}$

Difference of temperature 0.025  $\Delta t_L / \Delta t_z$   
 $(t_R - t_L)$  at  $\Delta t_L - 8 \text{ K} = 0.025 \times 8 = \sim 0.2 \text{ K}$   $\Delta t_L$

# Technical Data

## Type KS2

Positions 6 + 7



### Correction table, octave-centre frequencies


f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta LA$	-5	+6	-1	-9	-18	<-20	<-20	[dB]

### Insertion attenuation (incl. end reflection) Interior of box not insulated

f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta L$	21	13	16	11	16	15	29	[dB]


### Room air velocity Isotherm

$\bar{v}_{H1}$

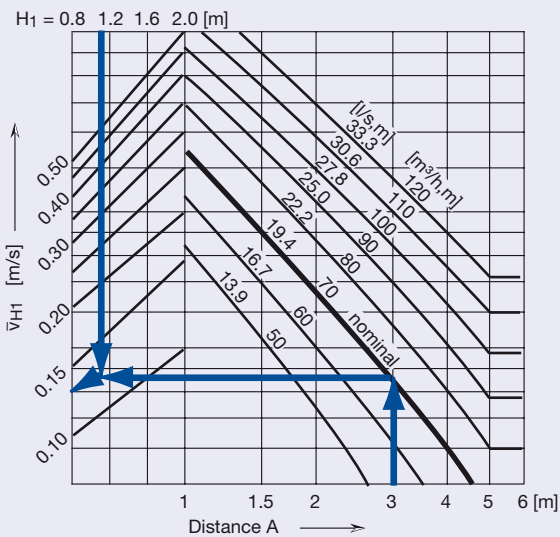


### Room air velocity by the wall $\Delta t_z = -8 K$

$\bar{v}_L$

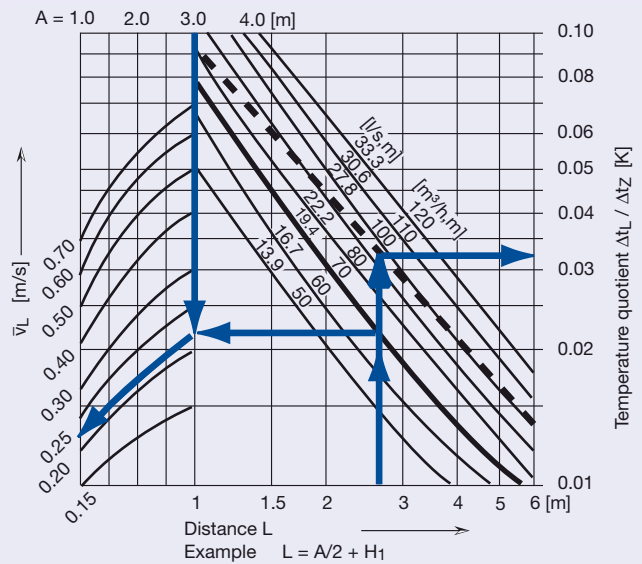


### Room air velocity $\Delta t_z = -8 K$

$\bar{v}_{H1}$

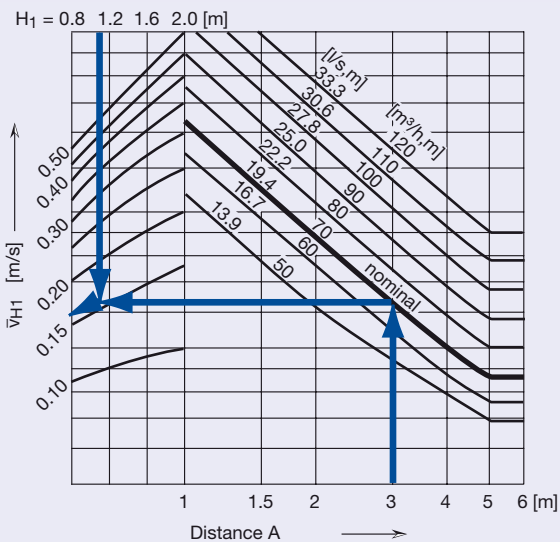


### Room air velocity $\Delta t_z = -12 K$

$\bar{v}_{H1}$

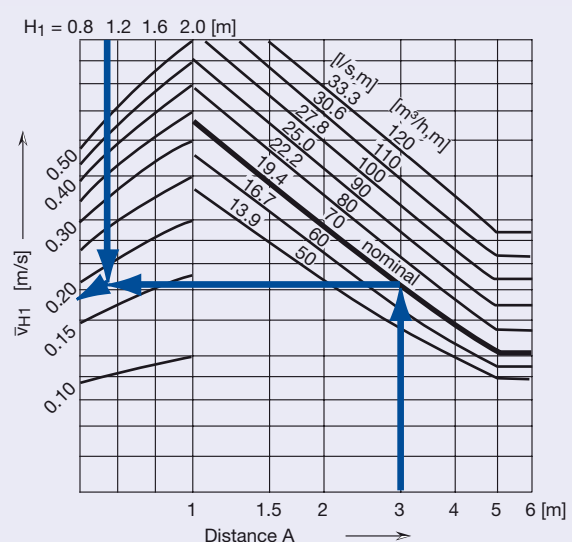


## Type KS2

Positions 6 + 7




Eff. air outlet surface area

$$A_{\text{eff}} = 0.0035 \text{ m}^2$$



## Sound power level and pressure drop

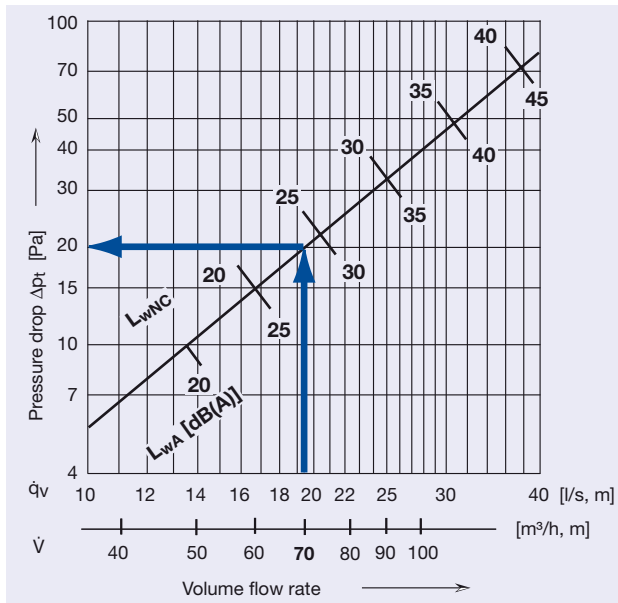

Correction of the sound power level  $L_{wA}$  and the pressure drop  $\Delta p_t$

Spigot $\varnothing$ [mm]	Length [mm]					
	1000		1500		2000	
	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -	$\Delta L_{wA}$ [dB]	$f_{\Delta p_t}$ -
1x 80	+4	1.6	+13	3.0	+20	4.9
1x100	0	1	+7	1.6	+13	2.4
1x125	-1	0.7	+5	1.0	+10	1.4
2x 80	-3	0.8	+2	1.1	+7	1.6
2x100	-5	0.6	-1	0.8	+3	1.0
2x125	-5	0.5	-1	0.6	+2	0.7

## Example

### Given

Type KS2...K220 (FW0066) pos. 6+7, 1 x  $\varnothing$  100 mm  
 Volume flow rate 19.4 l/s, m  $\dot{q}_v$   
 70 m³/h, m  $\dot{V}$   
 Room height 2.8 m H  
 Occupied zone height 1.7 m  
 Distance to the ceiling 1.1 m  $H_1$   
 Distance between diffusers 3.0 m A  
 Difference of temperature - 12 K / - 8 K / 0 K  $\Delta t$

### Solution

Sound power level 28 dB(A)  $L_{wA}$   
 Limite curve 23  $L_{wNC}$   
 Pressure drop 20 Pa  $\Delta p_t$

## Octave spectrum

f	125	250	500	1000	2000	4000	8000	[Hz]
$L_{wA}$	28	28	28	28	28	28	28	[dB(A)]
$\Delta L_A$	-5	+6	-1	-9	-18	<-20	<-20	[dB]
$L_{wOkt}$	23	34	27	19	<15	<15	<15	[dB]

## Insertion attenuation see p. 26


Room air velocity 1.7 m over ground  
 at - 12 K = 0.19 m/s  $\bar{v}_{H1}$   
 at - 8 K = 0.17 m/s  $\bar{v}_{H1}$   
 at Isotherm = 0.14 m/s  $\bar{v}_{H1}$

Difference of temperature 0.033  $\Delta t_L / \Delta t_z$   
 ( $t_R - t_L$ ) at  $\Delta t_L - 8 \text{ K} = 0.033 \times 8 = \sim 0.3 \text{ K}$   $\Delta t_L$

# Technical Data

## Type KS2WK100

Positions 6 + 7




### Correction table, octave-centre frequencies

f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta LA$	-5	+6	-1	-9	-18	<-20	<-20	[dB]


### Insertion attenuation (incl. end reflection) Interior of box not insulated

f	125	250	500	1k	2k	4k	8k	[Hz]
$\Delta L$	21	13	16	11	16	15	29	[dB]


### Room air velocity $\bar{v}_{H1}$ Isotherm

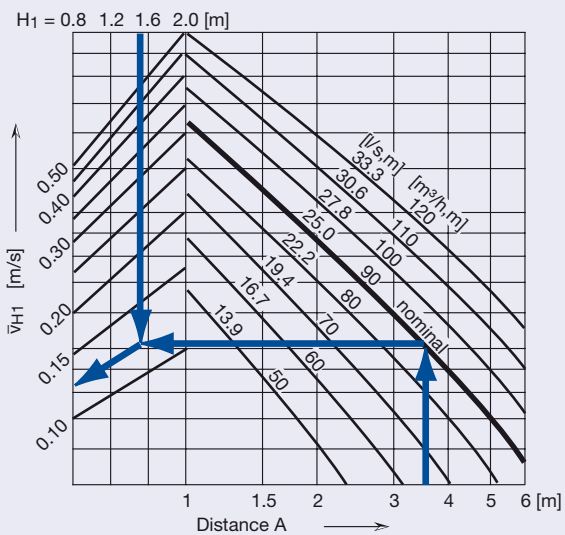


### Room air velocity by the wall $\bar{v}_L$ $\Delta t_z = -8 K$

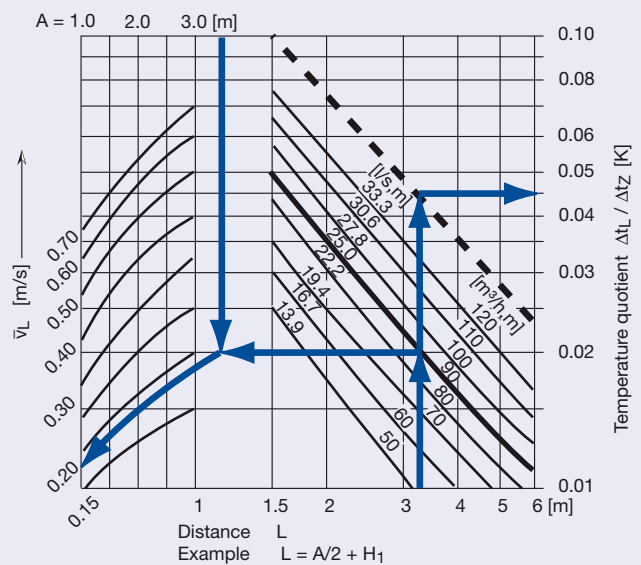

### Room air velocity $\bar{v}_{H1}$ $\Delta t_z = -8 K$

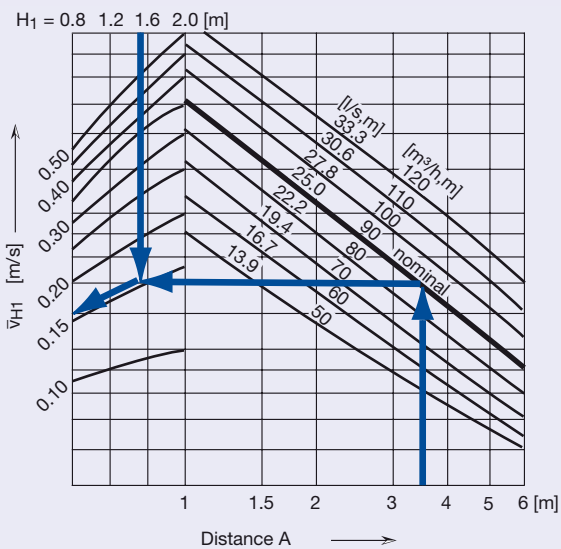


### Room air velocity $\bar{v}_{H1}$ $\Delta t_z = -12 K$

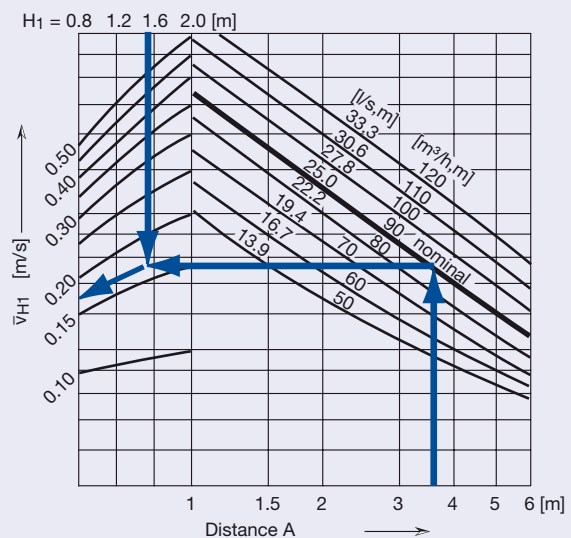



# Order Details

## Order codes

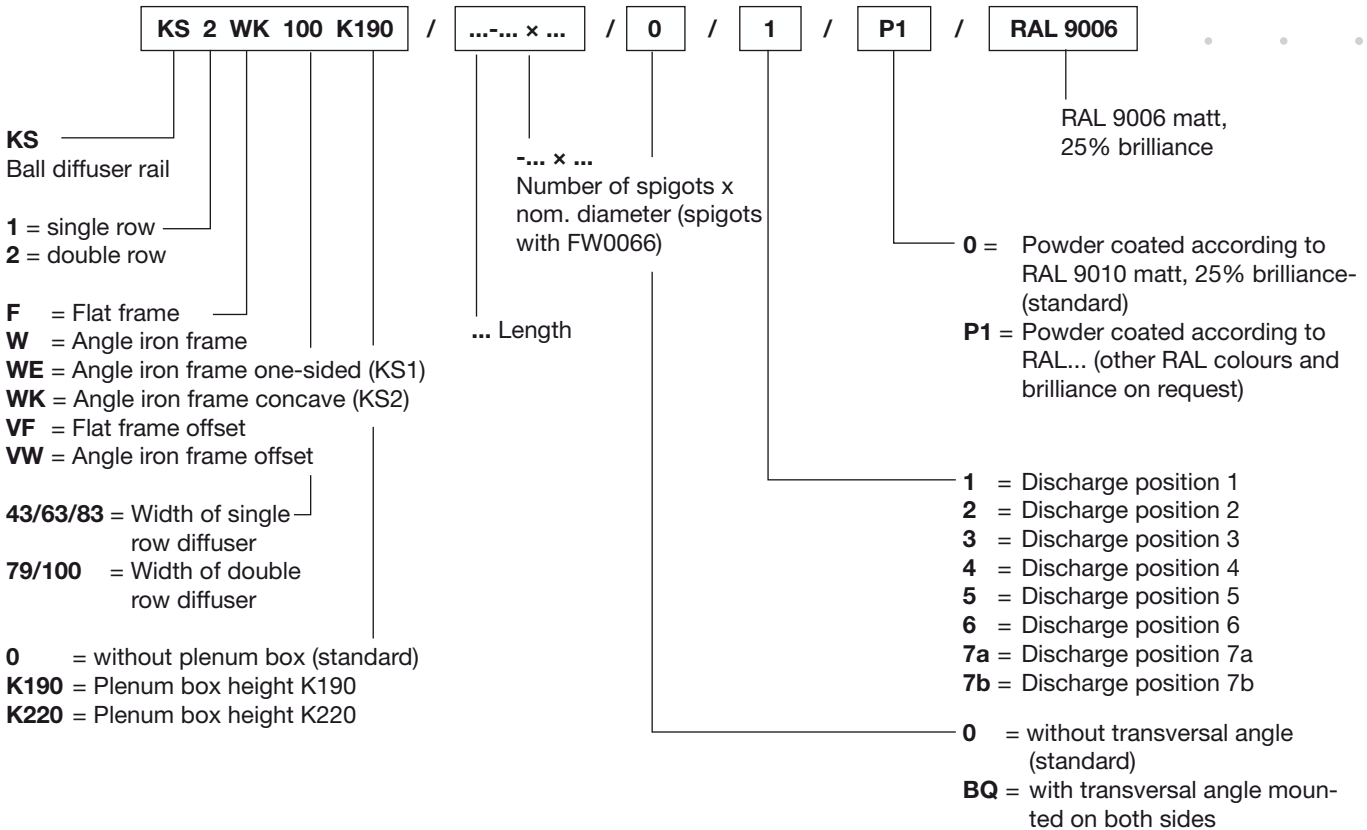

## Order examples

45 off KS1 WE 43 / 2000 / BQ / 2

40 off KS2 W 79 K220 / 1000 / BQ / 1 / P1 / RAL9006

## Text for tendering purposes

Ball diffuser rails with swivelling ball jets. Adjustment range of discharge direction 360° on all sides.

Consequently, they may be set to blow in small single jets or in one compact air jet. Air jet control along ceiling or in a room.

Also suitable for installation in a ceiling recess with offset ball arrangement. Air discharge suitable for variable air quantities of 100 to 25%.

Air diffuser consisting of swivelling ball jets made of synthetic material, which are held aluminium profiles by means of a clamping device. Setting of balls according to customer's instructions, pre-set at works. Connection box (with/without insulation) with round tube connection and integrated fixed resistance FW0066 including 4 aluminium brackets of galvanised metal sheet. Visible areas with matt lacquered finish according to RAL 9010, 25% brilliance.